


PLAN VIEW

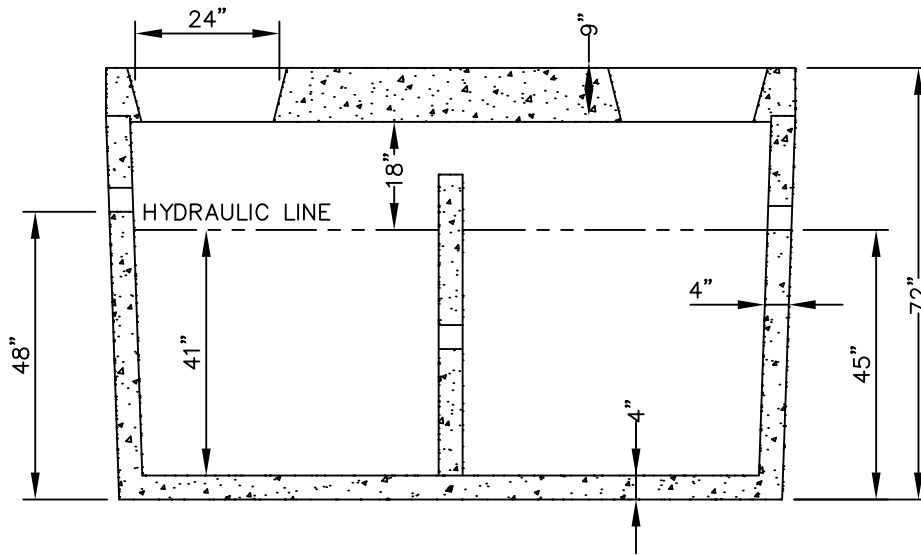

SECTION VIEW

SPECIFICATIONS

5000PSI WITH SUPER PLASTICIZER


BOTTOM AND SIDES ARE REINFORCED WITH 6X6X10 GAUGE WIRE

TOP IS REINFORCED WITH #4 GRADE 60 REBAR ON 12" CENTERS

RETENTION RATE: 24 GPM

POLYLOK III PRESSURE RATED RUBBER SEALS AVAILABLE UPON REQUEST

SET ON 4" MIN. GRAVEL BASE AND BACKFILL WELL-DRAINED GRAVEL OR NATIVE SOILS

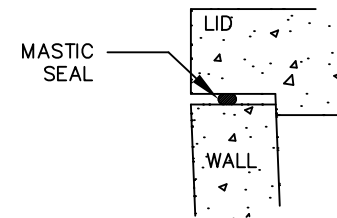

SEAL DETAIL

THIS DOCUMENT MAY NOT BE DISTRIBUTED, MODIFIED, ALTERED, OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR WRITTEN PERMISSION OF MARYLAND CONCRETE SEPTIC TANK INC.

REVISION	DATE	INITIAL	SIGNOFF
1			
2			
3			
4			
5			
6			
7			
8			

Maryland Concrete Inc.

1000 GALLON TWO COMPARTMENT GREASE TRAP

DRAWN: TLG 7/9/13

CHECKED:

SCALE: 3/8" = 1'

No. MC083

DATE	REVISION DESCRIPTION	DESIGNER/CHECKER
4		
3		
2		
0	ISSUED FOR CONSTRUCTION	