


PLAN VIEW

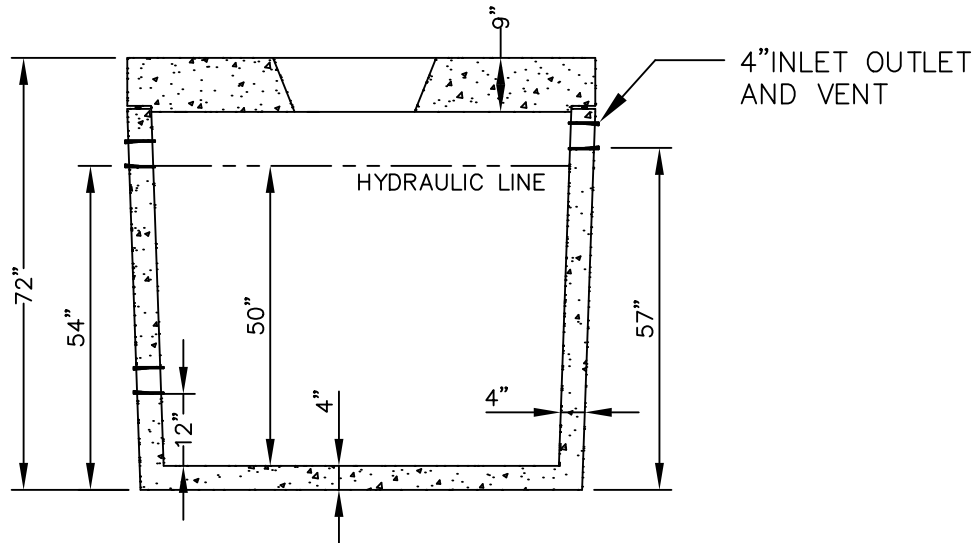

SECTION VIEW

NOTE: BAFFLES INSTALLED BY CUSTOMER

SPECIFICATIONS

5000PSI WITH SUPER PLASTICIZER


H-20 TRAFFIC RATED

BOTTOM AND SIDES ARE REINFORCED WITH GRADE 60 4x4x4 GAUGE WIRE

TOP IS REINFORCED WITH #4 GRADE 60 REBAR L.W. AND #5 BAR S.W.

POLY III PRESSURE RATED RUBBER SEALS INCLUDED

DESIGN APPROVED BY WSSC

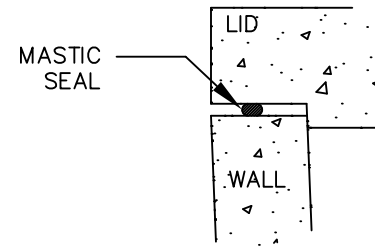

SEAL DETAIL

THIS DOCUMENT MAY NOT BE DISTRIBUTED, MODIFIED, ALTERED, OR REPRODUCED IN WHOLE OR IN PART WITHOUT THE PRIOR WRITTEN PERMISSION OF MARYLAND CONCRETE SEPTIC TANK INC.

REVISION	DATE	INITIAL	SIGNOFF
1			
2			
3			
4			
5			
6			
7			
8			

Maryland Concrete Inc.

500 GALLON SINGLE COMPARTMENT
WSSC SAND/ OIL/ GREASE INTERCEPTOR

DRAWN: JMH 6/4/13

CHECKED: TLG

SCALE: 3/8" = 1'

No. MC005-3

REVISION	DATE	DESCRIPTION	DESIGNER/CHECKER
4			
3			
2			
0	9/4/13	ISSUED FOR CONSTRUCTION	JMH/TLG